


Duct pressure control -
static transducer



Selectable safe position

Control component

XF4



Control component with spring return actuator for VAV terminal units for duct pressure control

Compact device for use with VAV terminal units

- Controller and static differential pressure transducer for duct pressure in one casing
- Separate actuator with spring return for adjustable safe position
- Duct pressure control in ventilation and air conditioning systems up to 550 Pa, e.g. line pressure control
- Suitable for clean and polluted air
- Constant value control P_{\min} or variable control $P_{\min} - P_{\max}$
- Operating parameters P_{\min} and P_{\max} are parameterised in the factory and saved in the controller
- Activation of override controls via external switch contacts
- Change of operating parameters using adjustment devices
- Service access for manual adjustment devices and PC configuration software

General information	2	Variants	6
Function	3	Technical data	7
Specification text	4	Product details	12
Order code	5	Explanation	15

General information

Application

- All-in-one control devices for duct pressure control
- Static differential pressure transducer and controller electronics combined in one casing
- Separate actuator with spring return
- Integration in central building management system or stand-alone operation
- Variable duct pressure control through setting setpoint e.g. values via analogue signal generated by the central building management system
- Constant value control for constant duct pressure without additional signalling thanks to parameterised operating value
- Override controls for the activation of shut-off, OPEN position, control stop possible via switch contacts or relay
- Duct pressure actual value is available as linear voltage signal

Control concept

- Duct pressure fluctuations are compensated
- To prevent the control from becoming unstable, a dead band is allowed within which the damper blade does not move.
- P_{\min} : selected operating value of minimum duct pressure or constant value
- P_{\max} : selected operating value of maximum duct pressure
- Operating parameters are specified via the order code and parameterised in the factory

Operating modes

Variable operation (V)

- Setpoint value setting via analogue interface
- Signal voltage range corresponds to P_{\min} to P_{\max}

Constant value mode (F)

- A setpoint value signal is not required
- Setpoint value corresponds to P_{\min}

Interface

Analogue interface with adjustable signal voltage range

- Analogue signal for pressure setpoint value
- Analogue signal for pressure actual value

Signal voltage ranges

- 0 – 10 V DC
- 2 – 10 V DC

Operating parameters

- Observe the variable duct pressure range from 25 – 550 Pa
- Reference point for the output signal: nominal pressure 600 Pa

Parts and characteristics

- Transducer for static measurement principle
- Overload protection
- Terminal connection for supply line and controls
- Socket plug for the actuator
- Terminals with cover
- Service interface
- Manual actuator adjustment with crank handle
- Raised actuator lockable with crank handle
- Raised actuator unlockable with crank handle

Note:

Differential pressure connections on the outside of the control unit are not accessible with this attachment depending on the variant, e.g. acoustic cladding.

Construction

GUAC-PM6 with spring return actuator 341C-024-05-V/ST06 for:

- TVR, TZ-Silenzio, TA-Silenzio, TVZ, TVA,
- TVRK up to NW 250

GUAC-PM6 with spring return actuator 361C-024-20-V/ST06 for:

- TVJ
- TVT up to dimensions of 1000 x 600
- TVRK from NW 315

Commissioning

- Due to the duct pressures set in the factory, always ensure that the control units are only installed in the specified locations
- Install the control unit and wire the control component
- Install the duct pressure tap and connect to the control component via tubing
- The controller is then ready for use
- Operating parameters can be adjusted by the customer via adjustment device, controller potentiometer including display or PC software.

Useful additions


- Adjustment device type GUIV2-A (order code AT-VAV-G)

Function

A static differential pressure transducer converts the duct pressure into a voltage signal. The differential pressure actual value is available as a voltage signal. The factory setting is such that 10 V DC always corresponds to the nominal differential pressure ($\Delta_{p, \text{nom}}$). The differential pressure setpoint value is either a constant value or it comes from a setpoint adjuster or from switch contacts. The controller compares the differential pressure

setpoint value to the actual value and controls the actuator accordingly. Differential pressure parameters and signal voltage range are stored in the control component. Changes on the customer's site can easily be carried out using an adjustment device or a notebook with service tool. If the supply voltage is interrupted or the wire breaks, the spring return actuator moves to the fail-safe position OPEN (NO) or CLOSED (NC) as specified in the order code.

Principle of operation for type 227P-024-15-DS6

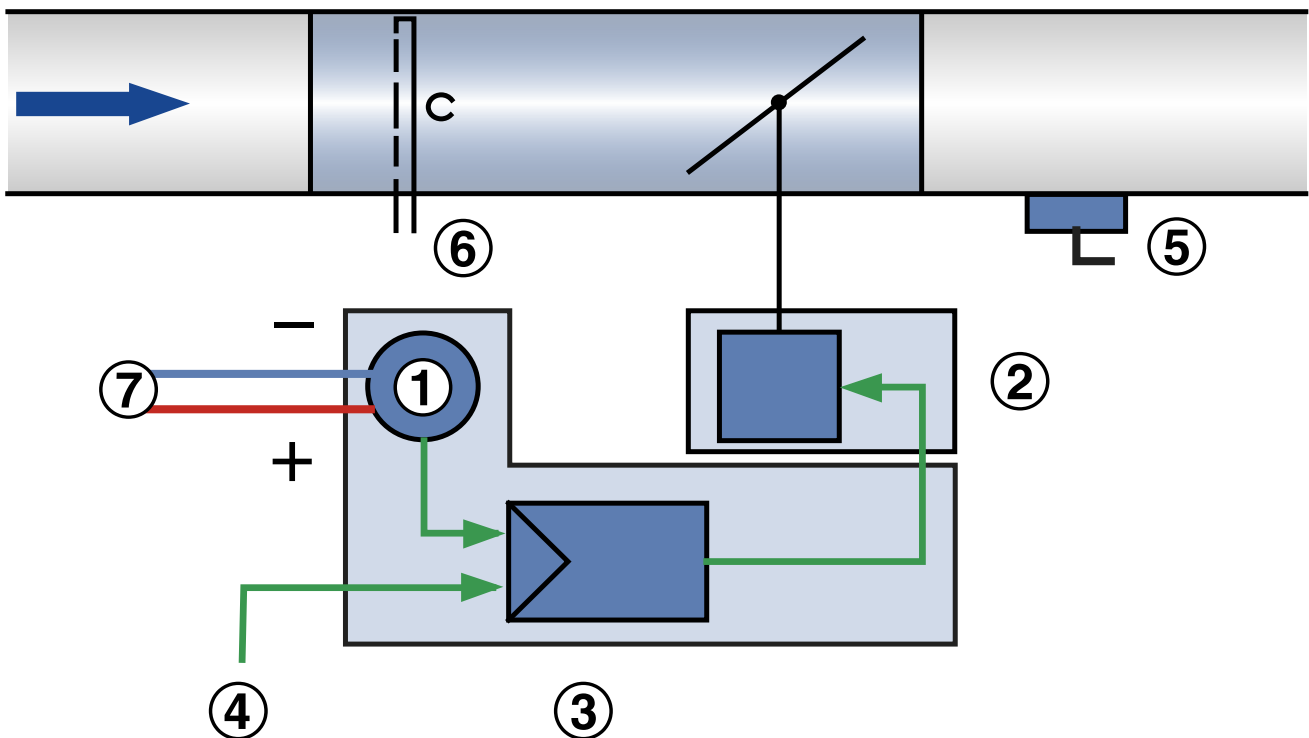

- ① Differential pressure transducer
- ② Actuator
- ③ Differential pressure controller
- ④ Setpoint value signal or programmed fixed constant value
- ⑤ Duct pressure tapping point
- ⑥ Differential pressure sensor of the VAV terminal unit (unused, depending on types and variant possibly not accessible or not

- available)
- ⑦ Differential pressure connection at the transducer of the control component, depending on the installation situation (supply air/exhaust air):
 - One connection side for duct pressure measurement - see ⑤
 - Use other connection side for pressure-stable reference measuring point

Specification text

This specification text describes the general properties of the product.

Category

- Universal controller for duct pressure with safe position

Application

- Control of a constant or variable duct pressure setpoint
- Electronic controller for connecting a reference value and for tapping an actual value signal
- The actual value signal relates to the nominal pressure such that commissioning and subsequent adjustment are simplified
- Stand-alone operation or integration in central building management system

Area of application

- Static transducer for duct pressure control in ventilation and air conditioning systems
- Control range 25 – 550 Pa

Actuator

- Spring return actuator for defined safe position of the damper blade in case of power failure
- run time max. 150s for 90°; run time spring return <20s for 90

Installation orientation

- either direction

Connection

- Connection terminals

Supply voltage

- 24V AC/DC

Interface/Control

- Analogue signal 0 – 10 V DC or 2 – 10 V DC

Interface information

- Analogue: Duct pressure setpoint and actual value

Special functions

- Display for volume flow actual value display and parameter setting
- Activation P_{min} , P_{max} , Closed, Open, Control Stop by means of external switch contacts/circuitry

Parameter settings

- Operating values P_{min} , P_{max} factory parameterised
- Signal characteristic factory parameterised
- Subsequent adjustment directly via control elements and display on the controller or by means of optional tools: adjustment device, PC software (wired in each case)

Order code

TVR – D / 200 / D2 / XF4 / PDS / V 0 / Pmin – Pmax Pa / NC
 | | | | | | | | | | |
1 2 5 6 7 8 9 10 11 12

1 Type
TVR VAV terminal unit

2 Acoustic cladding

No entry: none

D With acoustic cladding

3 Material

Galvanised sheet steel (Standard construction)

P1 Powder-coated RAL 7001, silver grey

A2 Stainless steel construction

5 Nominal size [mm]
100, 125, 160, 200, 250
6 Accessories

No entry: none

D2 Double lip seal both sides

G2 Matching flanges for both ends

7 Attachments (control component)
XF4 Universal pressure controller Static transducer

8 Equipment function/Installation location
PDS Duct pressure control, supply air

PDE Duct pressure control, extract air

9 Operating mode
F Constant value (a setpoint value)

V Variable (setpoint value range)

10 Signal voltage range
0 0 – 10 V DC

2 2 – 10 V DC

11 Operating values for factory setting

Duct pressure in Pa

 P_{const} (only with operating mode F)

 P_{vmin} (only with operating mode V)

 P_{vmax} (only with operating mode V)

12 Damper blade position
NO Power off to OPEN

NC Power off to CLOSE

Order example: TVR/100/D2/XF4/PDS/V0/300-500 Pa/NO
Acoustic cladding Without

Material Galvanised sheet steel

Nominal size 100 mm

Accessories Double lip seal both sides

Attachment Universal controller duct pressure, spring return actuator

Equipment function/Installation location Duct pressure control, supply air

Operating mode variable operation – signal voltage range 0 – 10 V DC

Operating value 300 – 500 Pa

Damper blade position NO, Power off to OPEN

Order example: TVJ-D/600x300/XF4/PDE/F2/450 Pa/NC
Acoustic cladding With

Material Galvanised sheet steel

Dimensions 600 x 300

Accessories None

Attachment Universal controller duct pressure, spring return actuator

Equipment function/Installation location Duct pressure control, extract air


Operating mode Constant value mode, signal voltage range 2 – 10 V DC

Operating value 450 Pa

Damper blade position NC, Normally CLOSED


Variants

Universal controller XF4, type GUAC-PM6

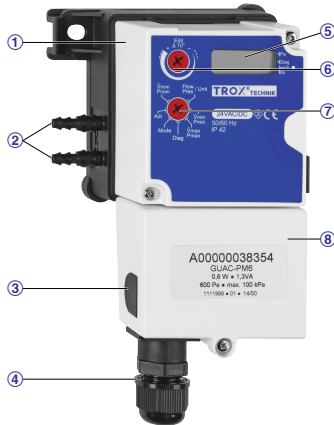

- ① Universal controller
- ② Differential pressure connections (+/-)
- ③ Alternative cable access
- ④ Cable gland for supply line
- ⑤ Display
- ⑥ Potentiometers
- ⑦ Selection setting menu
- ⑧ Connections behind removable cover

Universal controller XF4, type GUAC-PM6 (terminal cover opened)

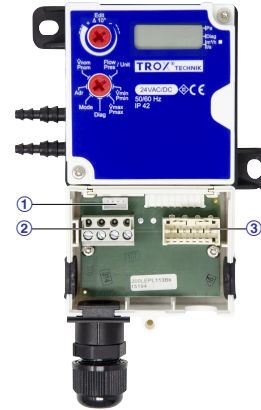

- ① Service connector
- ② Supply voltage and signal lines
- ③ Actuator connection

Actuator with spring return 361C-024-20-V/ST06



- ① Terminal block (drive shaft)
- ② Connecting cable
- ③ Casing actuator
- ④ Plug connection controller
- ⑤ Screws

Actuator with spring return 341C-024-05-V/ST06



- ① Terminal block (drive shaft)
- ② Connecting cable
- ③ Casing actuator
- ④ Plug connection controller
- ⑤ Screws

Technical data

Compact controllers for VAV terminal units

-	Controller		Spring return actuator		-
Order code detail	Part number	Type	Part number	Type	VAV terminal units
XF4	A00000038354	GUAC-PM6	A00000038357	341C-024-05-V/ST06	①
XF4	A00000038354	GUAC-PM6	A00000038355	361C-024-20-V/ST06	②

① TVR, TZ-Silenzio, TA-Silenzio, TVZ, TVA, TVRK up to NW 250

② TVJ, TVT up to dimensions 1000 x 500, TVRK from NW 315

Differential pressure controller GUAC-PM6

Differential pressure controller GUAC-PM6

Supply voltage (AC)	24 V AC $\pm 20\%$, 50/60 Hz
Supply voltage (DC)	24 V DC $\pm 20\%$
Power rating (AC)	5 VA max.
Power rating (DC)	Max. 2.5 W plus actuator used *
nominal pressure range	0 – 600 Pa plus actuator used *
pressure control range	25 – 550 Pa
Torque	15 Nm
Input setpoint value signal or override control	0 – 10 V DC, $R_a > 100 \text{ k}\Omega$ or 2 – 10 V DC, $R_a > 50 \text{ k}\Omega$ **
Actual value signal output	0 – 10 V DC or 2 – 10 V DC, 0.5 mA max.
IEC protection class	III (protective extra-low voltage)
Protection level	IP 42
EC conformity	EMC to 2014/30/EU
Weight	0.570 kg

* When dimensioning the transformers and the supply cable for the universal controller, the power consumption of the associated actuator must be taken into account.

** Input can be connected to supply voltage as part of override control.

Actuator with spring return 341C-024-05-V/ST06

Actuator with spring return 341C-024-05-V/ST06

Supply voltage	from the controller
Power consumption motor (movement)	5.0 W
Standby power consumption (end position)	2.0 W
Rating	7.5 VA
Torque	5 Nm
Running time for 90°	100 s
Spring return time	< 20 s
Setpoint value signal input	from the controller
IEC protection class	III (protective extra-low voltage)
Protection level	IP 54 (cable entry at the bottom)
EC conformity	EMC to 2014/30/EU
Weight	1.3 kg

Actuator with spring return 361C-024-20-V/ST06

Actuator with spring return 361C-024-20V/ST06

Supply voltage	from the controller
Power consumption motor (movement)	8.0 W
Standby power consumption (end position)	2.0 W
Rating	11.5 VA
Torque	20 Nm
Running time for 90°	150 s
Spring return time	< 20 s
Setpoint value signal input	from the controller
IEC protection class	III (protective extra-low voltage)
Protection level	IP54
EC conformity	EMC to 2014/30/EU
Weight	1.6 kg

XF4, Display


Note: Setting Adr without function

Display range of functions
Display functions

- Duct pressure actual value (unit Pa)
- Display via 3-character display with position valuation labelling (upstroke symbolises thousands of digits)
- Status and error display for various operating modes, including display of activated override control, display of diagnostic function
- Display of the firmware version

Setting options

- Work areas P_{min} , P_{max}
- Signal voltage range 0 – 10 V or 2 – 10 V DC

Diagnostic function

- Activation of override controls OPEN, CLOSED, q_{min} , P_{max} , motor stop

Commissioning

- On-site adjusting is not required
- Due to the duct pressures set in the factory, always ensure that the control units are only installed in the specified locations
- Install control unit in the duct range to be controlled
- Set up pressure tap for duct pressure
 - For supply air:
 - Connect differential pressure connection "+" of the controller to the duct to be regulated
 - Use differential pressure connection "-" of the controller for pressure-stable reference measuring point
 - For extract air:
 - Use differential pressure connection "+" of the controller for pressure-stable reference measuring point
 - Connect differential pressure connection "-" of the regulator to the duct to be regulated
- The connection for the pressure tapping point on the duct must always be made on the side facing away from the fan
- Note duct pressure control ranges as per technical data
- Establish electrical wiring connection
- The controller is then ready for use

Product details

Analogue interface 0 – 10 V or 2 – 10 V DC (operating mode V, F)

The analogue interface can be adjusted for the signal voltage range 0 – 10 V DC or 2 – 10 V DC. The assignment of the duct pressure setpoint value or actual value for voltage signals is shown in the characteristic curves.

- The set signal voltage range always applies equally for setpoint value and actual value signals.
- The signal voltage range is pre-set in the factory according to the order code entries.
- Signal voltage range can be adjusted on site in the adjustment menu on the display, via adjustment device or PC software.

Setpoint value setting

Variable operation

- In the operating mode V (variable operation), the setpoint value is specified with an analogue signal on terminal Y.
- The selected signal voltage range 0 – 10 V or 2 – 10 V DC is assigned to the pressure range P_{\min} – P_{\max} a change packet.
- Operating values P_{\min} – P_{\max} pre-set in the factory according to the order code entries.
- Subsequent adjustment of P_{\min} or P_{\max} can be adjusted in the adjustment menu on the display or with adjustment device or PC software

Constant value mode

- In operating mode F (constant value mode), an analogue signal on terminal Y is not required.
- The volume flow rate constant value set by P_{\min} is regulated.
- Operating value P_{\min} is pre-set in the factory according to the order code entry.
- Subsequent adjustment of P_{\min} can be adjusted in the adjustment menu on the display or with adjustment device or PC software

Actual value as feedback for monitoring or tracking control

- The actual duct pressure rate measured by the controller can be tapped as a voltage signal at terminal U.
- The selected signal voltage range 0 – 10V DC or 2 – 10V DC is shown in the pressure range 0 – P_{Nominal} shown.
- Reference point $P_{\text{Nominal}} = 600$ Pa

Override control

For special operating situations, the duct pressure controller can be put in a special operating mode (override control). The following are possible: control P_{\min} , control P_{\max} , damper blade in the OPEN position, damper blade CLOSED.

Under certain conditions the control can also be suspended (control stop).

Override control via signal input Y

- With appropriate wiring on the signal input Y, the override controls can be activated according to the connection diagrams via wiring with external switch contacts/relays.
- OPEN and CLOSED are only available if the controller is supplied with alternating current (AC).
- In the signal voltage range 2 – 10 V, the differential pressure control can be suspended (stop) by connecting input Y to GND.

Override control CLOSED via control signal Y

- With signal voltage range 0 – 10 V DC: CLOSED is activated when $P_{\min} = 0$ is set and the control signal is $Y < 0.5$ V DC.
- With signal voltage range 2 – 10 V DC: CLOSED is activated when control signal is $Y < 0.8$ V DC (0.8 V = factory setting).
- The specified switching point of 0.8 V corresponds here to the factory default setting.

Override controls for diagnostic purposes

- For test purposes, the override control can also be activated via the integrated display, adjustment device or PC software.


Prioritisation of various setting options

- High priority: specifications via the display, adjustment device or PC software
- Low priority: settings via wiring on the Y signal input of the controller

Spring return actuator

- The spring return function in case of power failure is prepared at the factory according to the order option. NC = damper CLOSED, NO = damper OPEN. On site, this function cannot be changed by parameterisation via service tools.

Characteristic of the setpoint value signal

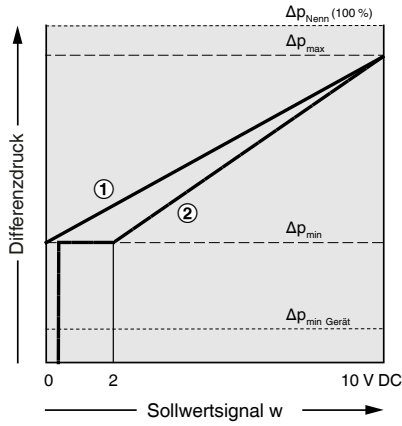

- ① 0 – 10 V DC
- ② 2 – 10 V DC

Differential pressure setpoint value

0 – 10 V DC


$$\Delta p_{\text{Soll}} = \frac{w}{10} (\Delta p_{\text{max}} - \Delta p_{\text{min}}) + \Delta p_{\text{min}}$$

Differential pressure setpoint value

2 – 10 V DC

$$\Delta p_{\text{Soll}} = \frac{w-2}{8} (\Delta p_{\text{max}} - \Delta p_{\text{min}}) + \Delta p_{\text{min}}$$

Characteristic of the actual value signal

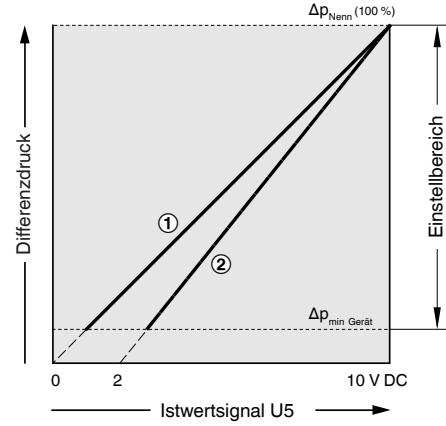

- ① 0 – 10 V DC
- ② 2 – 10 V DC

Differential pressure actual value

0 – 10 V DC


$$\Delta p_{\text{Ist}} = \frac{U5}{10} \Delta p_{\text{Nenn}}$$

Differential pressure actual value

2 – 10 V DC

$$\Delta p_{\text{Ist}} = \frac{U5-2}{8} \Delta p_{\text{Nenn}}$$


View of the pluggable terminal strip of the GUAC-PM6

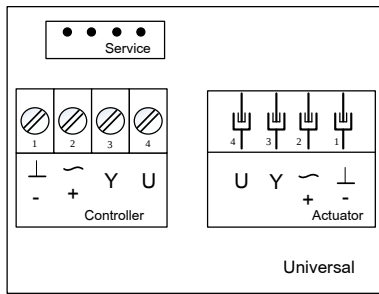

Service: Connection socket for the adjustment device
 Actuator: Connection socket for the actuator
 Controller: power supply and signal lines

Controller:
 1 ⊥, - = Ground, neutral
 2 ~, + = Supply voltage 24 V
 3 Y = setpoint value signal Y and override controls
 4 U/pp = actual value signal U or adjustment device or interface adapter GUIV-S for PC software

Variable duct pressure control and override control

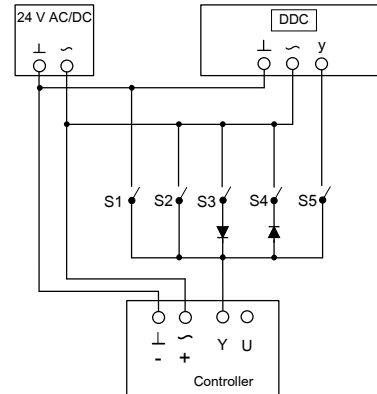

- S1: (0 – 10 V)
 - If $P_{min} = 0$ set, then damper CLOSED
 - If $P_{min} > 0$ is set, then P_{min}
- S2: (2 – 10 V)
 - Control stop
- S2: Setpoint value setting P_{max}
- S3: Damper blade OPEN (only with supply voltage 24 V AC)
- S4: Damper blade CLOSED (only with supply voltage 24 V AC)
- S5: Setpoint value setting - variable duct pressure via control signal

All switches open (input open): Constant value mode with setpoint value setting P_{min}

DDC = Setpoint value setting
When combining several override controls the switches must be interlocked to prevent short-circuits.
Diode: e.g. 1N 4007

Explanation

P_{Nom} [Pa]

Nominal pressure (100 %): Maximum differential pressure that can be detected by the pressure transducer and converted into an electrical signal. Please note that the adjustable differential pressure range is only a range of the nominal pressure and cannot be fully utilised (see technical data). P_{Nom} is the reference value for defining P_{min} and P_{max} .

P_{max} [Pa]

Upper limit of the operating range of the duct pressure regulator adjustable by the customer: P_{max} can only be set up to approx. 90 % of P_{Nom} (see technical data for the usable control range).
With analogue control of duct pressure controllers (typically

used), the maximum value of the setpoint signal (10 V) is assigned the set maximum value (P_{max}) (see characteristic curve).

P_{min} [Pa]

Lower limit of the work area of the duct pressure controller, adjustable by the customer: P_{min} should only be set less than or equal to P_{max} . Do not set P_{min} lower than the lower control range, otherwise control is unstable. With analogue control, the set minimum value P_{min} is assigned to the minimum value of the setpoint value signal (0 or 2 V) (see characteristic).

P [Pa]

Differential pressure